


Suggested layout proposal!

System 0.PS-S-Plan.01




Note: In Menu Boiler, item SERVICE set Parameter VARIABLE MODE ACTIVATED to „YES“.
Set DHW priority to „YES“. Controller P 3200.

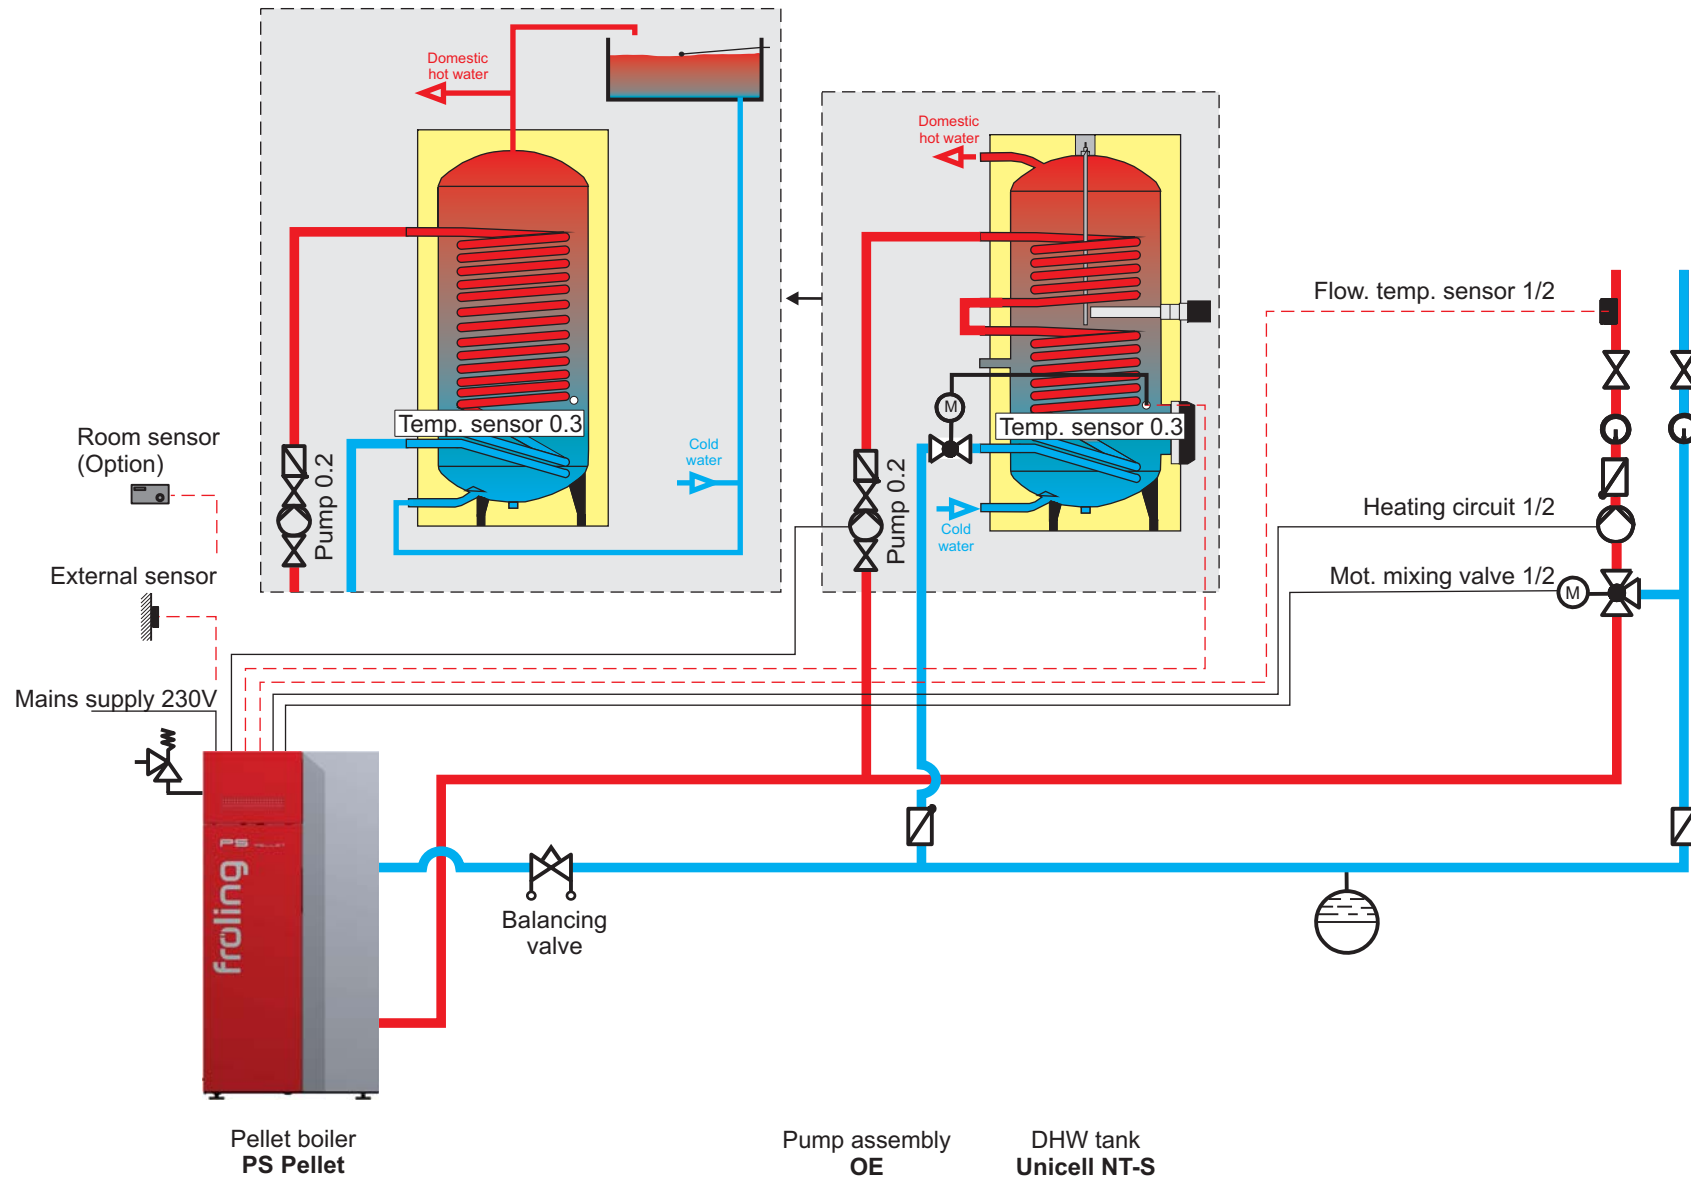

	Name	Date	Remarks
Signed	Krl	18.05.12	
Checked by			

Suggested layout proposal!

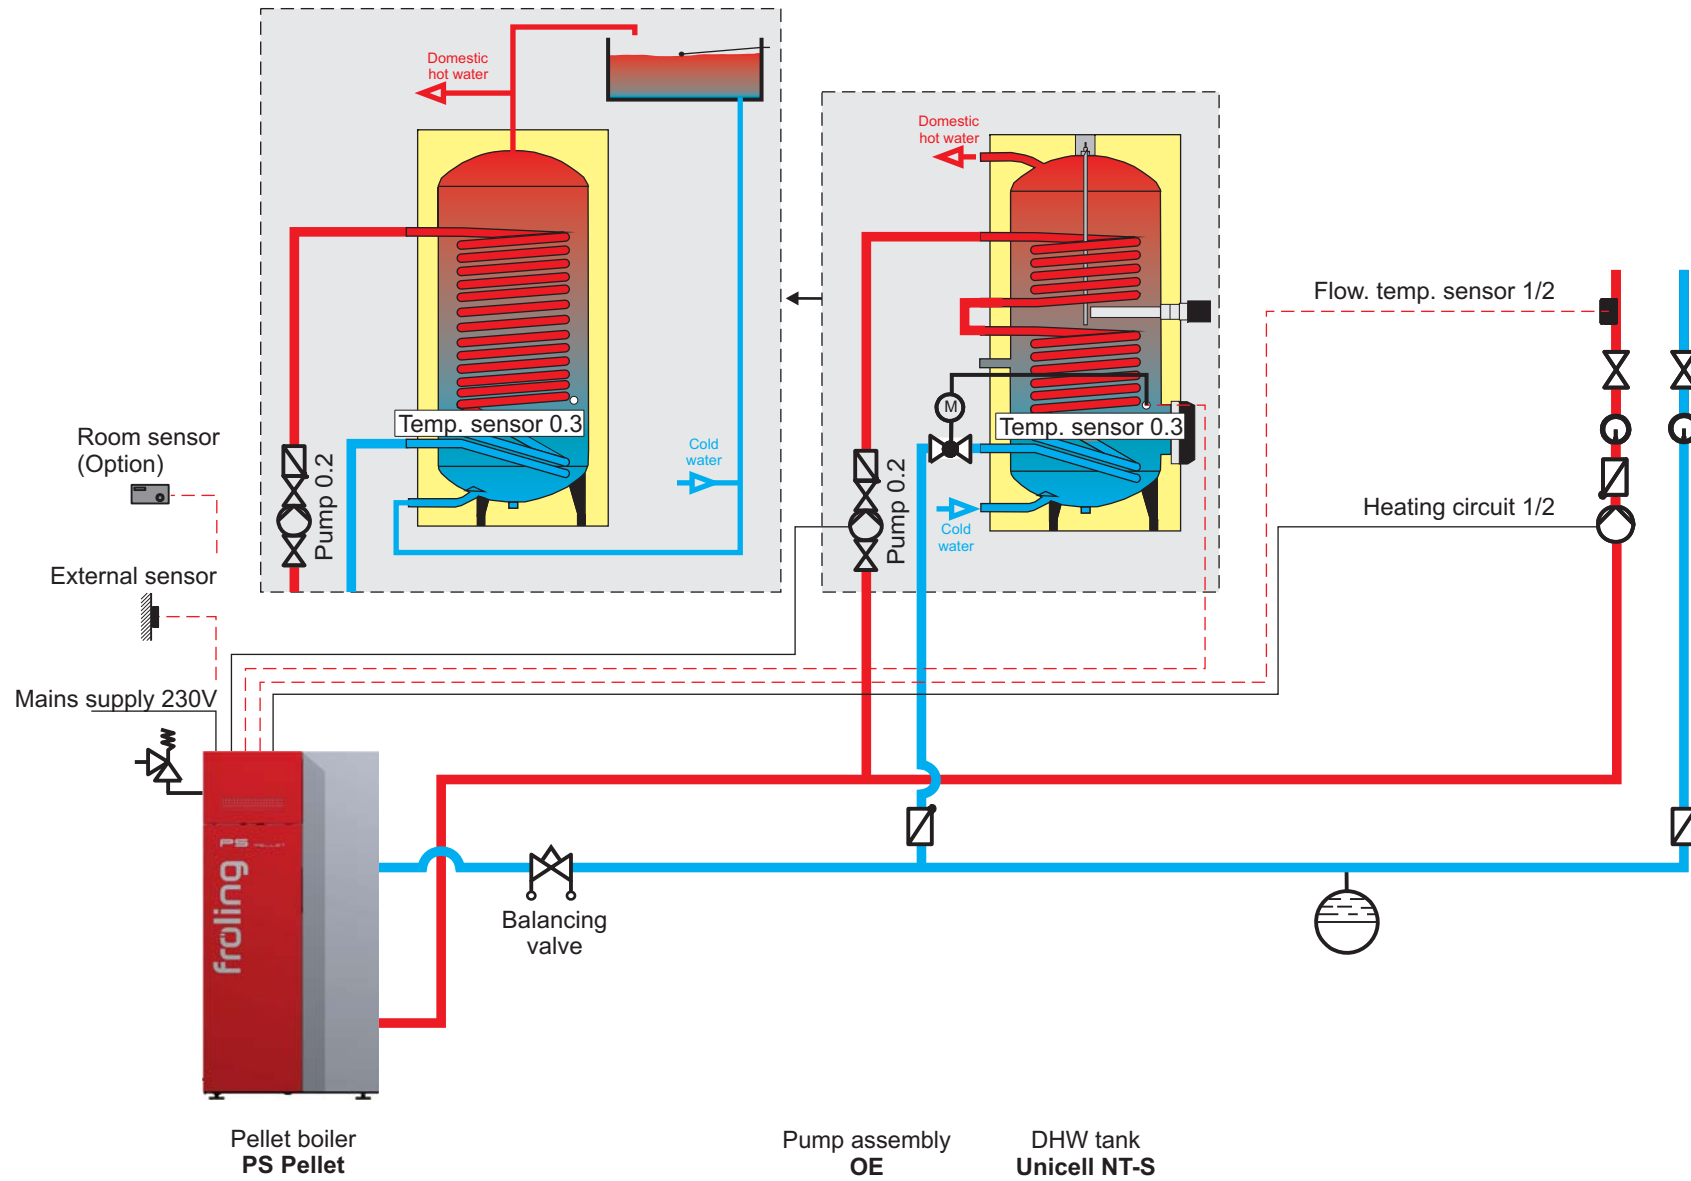

Note: In Menu Boiler, item SERVICE set Parameter VARIABLE MODE ACTIVATED to „YES“.
Set DHW priority to „YES“. Controller P 3200.



	Name	Date	Remarks
Signed	Krl	18.05.12	
Checked by			